NC-PF2-SC

Conventional Fire Panel with Scandinavian Key - 2 Zone

Overview

The New Conventional fire control panels offer state of the art architecture in configurations that deliver an uncomplicated solution for small to mid-sized conventional applications. With their clean and attractive contemporary design, they fits with any decor. The basic and intuitive user interface with icons make easy their application everywhere without an additional language kit required.

With support for multiple lines of conventional detectors and accessories, these quick-to-configure systems offer versatility that benefits building owners and installation/maintenance companies alike.



The Panel

The NC-PF2-SC is a conventional fire alarm control panel with Scandinavian key support. It is supplied with 2 zones that support up to 32 devices per zone, as well as up to 2 supervised relay outputs dedicated to sounder control. In addition 2 conventional relay outputs dedicated to common fire and fault conditions, as well as two user configurable inputs for monitoring and control are available.

Options

The panels support 2 types of auxiliary relay boards, one with 4 standard relays, and one with 4 supervised relays. With these boards the panel outputs may be expanded with up to 8 additional outputs.

Approvals & Compliance

The product line carries the following accreditations:

• EN54:2, EN54:4 and CE approved
• CPD certified
• NEN2535, NBNS21-100 and BS5839-1 compliant

• WEEE compliant
• RoHS compliant

Type class conditions: 3K5 of IEC 60721-3-3

Details

- Modern, elegant design with basic and intuitive user interface with icons.
- Easy removable parts for quick and clean installation
- Default regional setup modes
- Normal, head-out & intrinsically safe zone support
- Supervised alarm notification outputs
- EN54 compliant potential free fire & fault relays
- Class change, day/night & remote reset facilities
- Auxiliary 24VDC supply output with reset support
- Default support for special functions such as: - EN54 compliant user access levels - mixed zones - full front panel diagnostics - one-man walk test - CleanMe™
- Auxiliary standard & supervised relay output boards
- Networkable up to 64 zones
- No language kit inserts required

NC-PF2-SC

Conventional Fire Panel with Scandinavian Key - 2 Zone

Technical specifications

General

Maximum system capacity (device count)	up to 1280
Network size (nodes)	up to 32

Electrical

Power supply type	VAC
Power consumption	2 A @ 24 VDC
Operating voltage	110 VAC @ 50 Hz or 230 VAC @ 50 Hz (+10% -15%) Cable type: 3 x 1.5 mm² (live, neutral, earth)
Current consumption	2 A @ 110/240 VAC 130 mA (alarm, no devices) (panel supply) 50 mA (quiescent, no devices) (panel supply)

Loop

Maximum loop capacity	2

Zone

Maximum zone capacity	up to 2
Operating voltage	22 VDC (18 to 24 VDC)
Quantity of devices per zone	32 max.
Rating	65 mA (max. Load)
Cable rating	40 ohm (max. resistance), 500 nF (max. capacitance)

Input

Input quantity	2
Input type and rating	100 ohm (max. cable resistance)

Output

Supervisory voltage	-15 to +28 VDC
Auxilliary power	24 VDC (21 to 28 VDC)
Supervised Outputs	2
Load (max.)	250 mA
Non Supervised Outputs	2
Load	2 A @ 30 VDC

Standby battery

Capacity	2 x 12 V, 7.2 Ah (SLA)

Physical

Form factor	Small
Physical dimensions	320 x 435 x 134 mm (W x H x D)
Net weight	2.8 kg (without battery)
Shipping weight	4.5 kg
Colour	Grey (RAL 7035)
Mounting type	Surface mount
Cable entries	Ø 20 mm - 14 / 2 / 12 (top / bottom / rear)

Environmental


Operating temperature	-5 to +50°C
Storage temperature	-20 to +70°C
Relative humidity	10 to 95% noncondensing
Environment	Indoor
IP rating	IP30

Regulatory

Compliancy	CPD, RoHS, WEEE
Certification	EN54-13, EN54-2, EN54-4

Auxilliary Supply Output

Load (max.)	250 mA @ 25°C / 195 mA @ 40°C

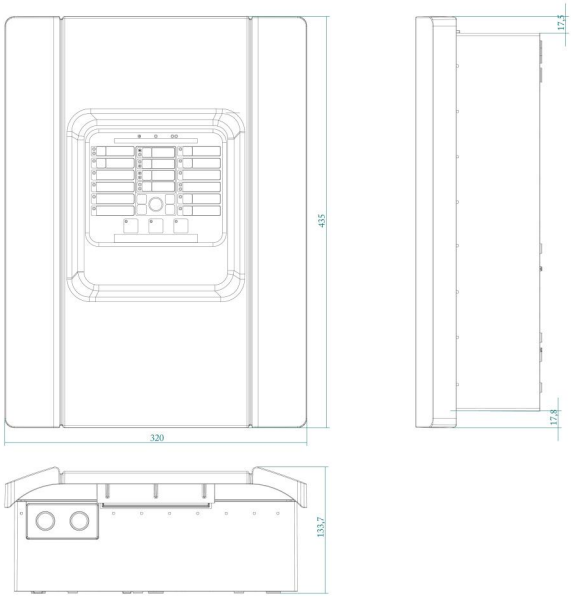

KIDDE COMMERCIAL

As a company of innovation, Kidde Global Solutions reserves the right to change product specifications without notice. For the latest product specifications, visit firesecurityproducts.com online or contact your sales representative.

Last updated on 1 October 2026 - 13:15